

कार्यालय सहायक यंत्री लोक स्वास्थ्य यांत्रिकी उपखण्ड उमरिया (म.प्र.)

पत्र क्रमांक / 08 / तक. / सहा.यं. / लो.स्वा.यां.उपखण्ड / 2022 उमरिया दिनांक 05/01/2022

प्रति,


प्राचार्य / प्रबंधक
सेन्ट एलायसिस सीनियर सेकेण्डरी स्कूल
बिरसिंहपुर पाली
जिला उमरिया (म0प्र0)

विषय:- पीने के पानी की गुणवत्ता का परीक्षण रिपोर्ट प्रेषित करने बावत्।

संदर्भ:- आपका कार्यालयीन पत्र दिनांक 05.01.2022
---000---

उपरोक्त विषयांतर्गत लेख है कि संदर्भित पत्रानुसार आपके द्वारा प्रेषित 01 नग जल नमूने का भौतिक, रासायनिक एवं जीवाणु परीक्षण कर परीक्षण रिपोर्ट आपकी ओर आवश्यक कार्यवाही हेतु प्रेषित है।

सहपत्र:- 1. जल परीक्षण रिपोर्ट 33
2. परीक्षण शुल्क रिपोर्ट रू. 1550.00


सहायक यंत्री
लोक स्वास्थ्य यांत्रिकी
उपखण्ड उमरिया (म.प्र.)

DISTRICT WATER TESTING LABORATORY
(National Drinking Water Mission)
Public Helth Engineering Depptt. Umaria (M.P.)
 Block- PALI

District: Umaria

Village
 GORAIYA
 (PALI PROIECT)

Code No.03
 SA.NO.& Detail of & Location

Particular of Sample

1. Date of collectin-05-01-2022


2. Date of Analysis-05-01-2022

(i) T.W. LTD. IN ST.ALOYSIUS SR SEC SCHOOL PALI

Reference:(IF any)

Table-2.2 BIS Standard: IS-10500-2012(Second Revision)					
S.No.	Chareacterisitics	Unit	Acceptable	Cause for Rajection	S.No.-31
	Physical Test				
1	Turbidity	N.T.U.	1	5	4.5
2	Colour	Hazen Units	5	15	5.0
3	Taste		Agreeable	Un Agreeable	Agreeable
4	Odour		Un Objectionable	Objectionable	Un Objectionable
	Chemical Taste				
5	PH	PH Scale	7.0-8.5	7.0-8.5	7.5
6	Total Alkalinity	Mg/l	200	600	180
7	Chiorides (As Cl)	Mg/l	250	1000	60
8	Arsenic	Mg/l	0.01	0.05	NIL
9	Magnease	Mg/l	0.1	0.3	NIL
10	Nitrates (As NO3)	Mg/l	45	45	NIL
11	Total Hardness (As CaCo3)	Mg/l	200	600	300
12	Total Dissolved Solids	Mg/l	500	2000	135
13	Iron (As Fe)	Mg/l	0.3	1	0.3
14	Fluordes (As F)	Mg/l	1	1.5	0.4
15	Sulphates (As SO4)	Mg/l	200	400	45
16	Residual Chlorine	Mg/l	0.2	1	NIL
	Bactrological Test				
17	Coliform Organism at 370C	M.P.N./100 ml.	NIL	NIL	NIL


REMARK- Filtration and Chorination is must necessary before use drinking purpose.

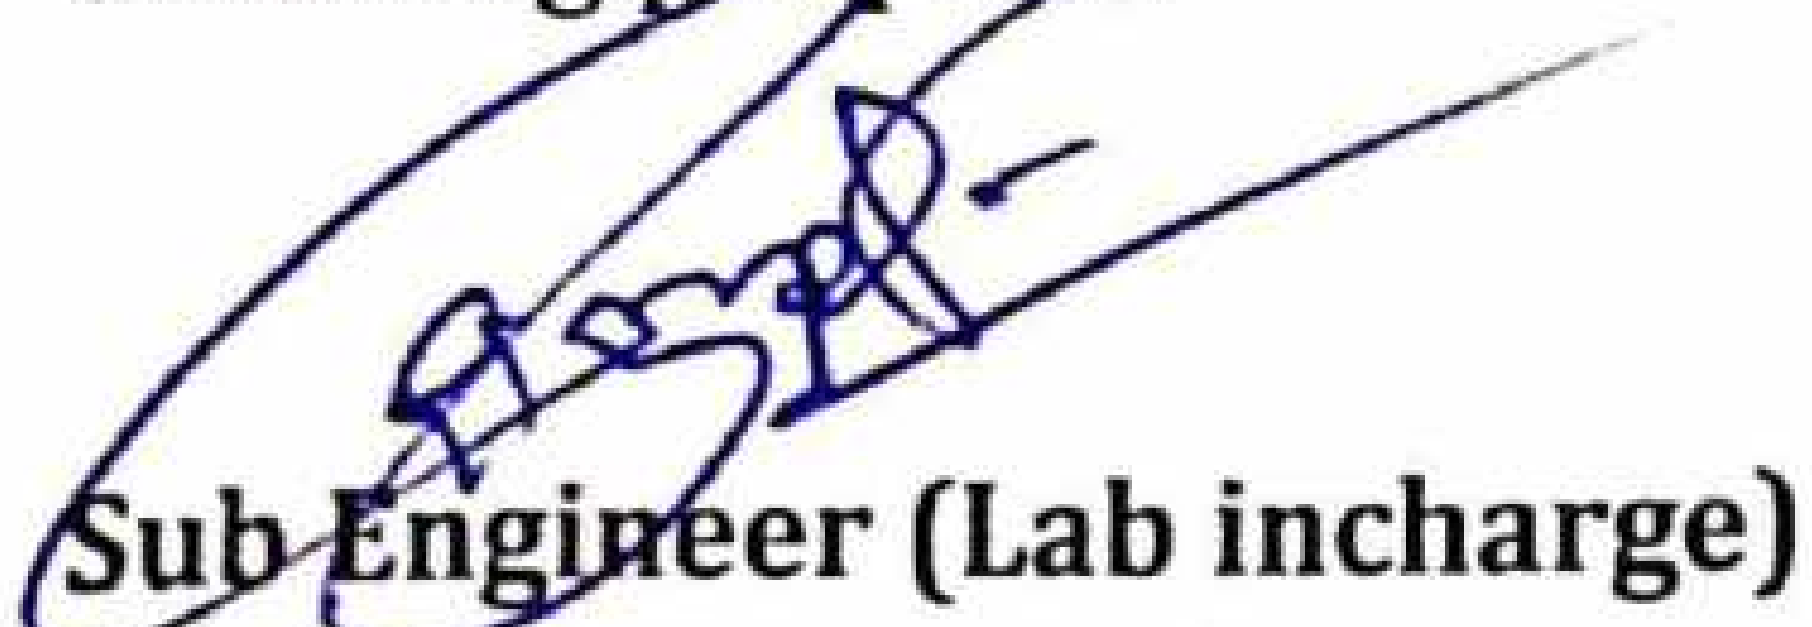
 Sub Engineer (Lab incharge)
 Name& Singature

PHE SUB DIVISION UMARIA (M.P.)


 Reaserch Assistant
 Name& Singature

PHE SUB DIVISION UMARIA (M.P.)

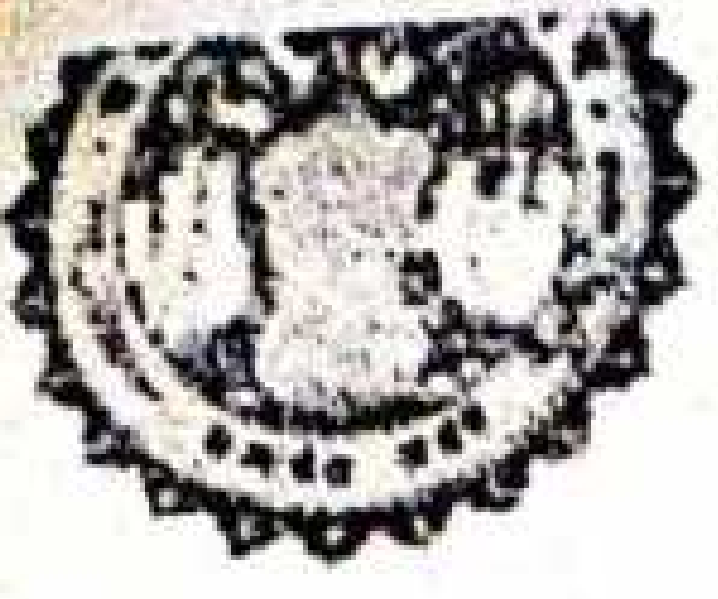

Department of Finance, Government of Madhya Pradesh
Acknowledgement Receipt for Online Tax Payment
to M.P. State Government



TIN (Tax payment Identification Number) / Enrollment / Registration No.	-
Depositor/Dealer Name	Principal
Address	ST ALOYSIUS SR SEC, SCHOOL, BIRSINGHPUR PALI, Umaria, Madhya Pradesh - 484551
Unique Registration Number (URN)	MPTURN050120220005753
Department and Office Name	Common Challan Entry,
Challan Payment Period	2021-2022

Purpose Details

CRN	Assessment/ Concerning Period	Head of Account	Challan Identification Number (CIN)	Challan No.	Amount(Rs.)
MPT021505012022000004	2022-01-05 to 2023-01-04	0215-01-800-0000 (Other Receipts)	SBIN0006159021505012022687516	051/9999999/0215/01/22/000010	1550.00

Total Amount(In figures)	1,550.00
Total Amount(In words)	One Thousand Five Hundred Fifty Rupees Only
Name and Code of the Bank	STATE BANK OF INDIA (2)
Bank Reference Number	IKOBLTYJR6
Scroll No	68675
Scroll Date	05/01/2022
Date of Transaction / Time of Transaction (HH24:mm:ss)	05/01/2022 14:40:01
Transaction Status	Success